
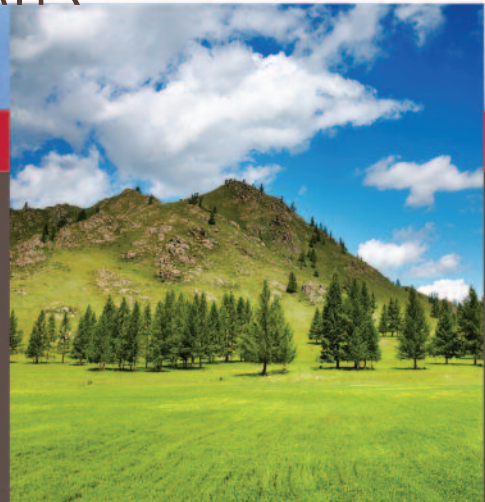


CLEANCOMPRESSED AIR



THE NORGREN GUIDE
to effective air preparation

COMPRESSED AIR IS OFTEN, WRONGLY ASSUMED TO BE A CHEAP OR EVEN ‘FREE’ SOURCE OF POWER. IN FACT IT CAN BE 10 TIMES AS EXPENSIVE AS ELECTRICITY BY THE TIME ALL GENERATION, TRANSMISSION, TREATMENT AND SYSTEM COSTS ARE TAKEN INTO ACCOUNT.

Good air preparation must therefore consider the energy consumption of the system and air treatment equipment. Norgren’s core business of air preparation is over 80 years old now and although there have been many changes in products, materials and production technologies, the basic principles have not really changed. What has changed is the cost of producing air to the

correct standard to make machines run as efficiently as possible. The cost of wasted energy not only in financial terms, but also the cost to the environment and planet are factors that make the selection and application of correct conditioning equipment more important than ever before. Having invented the automatic airline lubricator in 1927 Norgren effectively began the practice of air preparation.

Delivering air of the right quality to a pneumatic device to enable that device to run at it’s optimum efficiency for the longest possible time, keeping life costs to a minimum. From then until now Norgren have offered advice on all types of systems. Back in the 1970’s the first Clean Compressed Air guide was published, this the third issue brings that guidance up to date to meet the changing demands of the 21st Century. The aim of this booklet is to offer guidance on the correct, economic and safe treatment of compressed air in industrial applications. Here we can only provide a brief summary of the extensive experience Norgren has as a world leader in FRL technology. The following pages cover the issues involved with air preparation and factors to consider. For those without time to digest this guide fully the TYPICAL APPLICATIONS section shows the best practice for the most common types of pneumatic applications.

>> CONTENTS

Air Facts	4
Generation, Distribution and Treatment	5
Removing Contaminants	6
Liquid Water	6
Water Vapour	6
Solid Particles	8
Oil	9
Oil Aerosols	9
Oil Vapour	10
Filter Selection	10
Pressure Control	12
Types of Regulators	13
Regulator Selection	15
Filter/Regulators	15
Lubrication	16
Aerosol Lubrication	16
Centralised Lubrication	17
Direct Injection	17
Filling Lubricator Bowls	18
Lubricator Selection	18
Excess Pressure Control and Environment Protection	19
Overpressure protection	19
Types of Relief Valves	20
Soft Start/Dump Valves	20
Exhaust Air	21
Protection Device Selection	21
Other Products for Safer Systems	21
Typical Applications	22
Norgren Air Preparation Product Overview	24
Glossary	28
Reference Tables	29

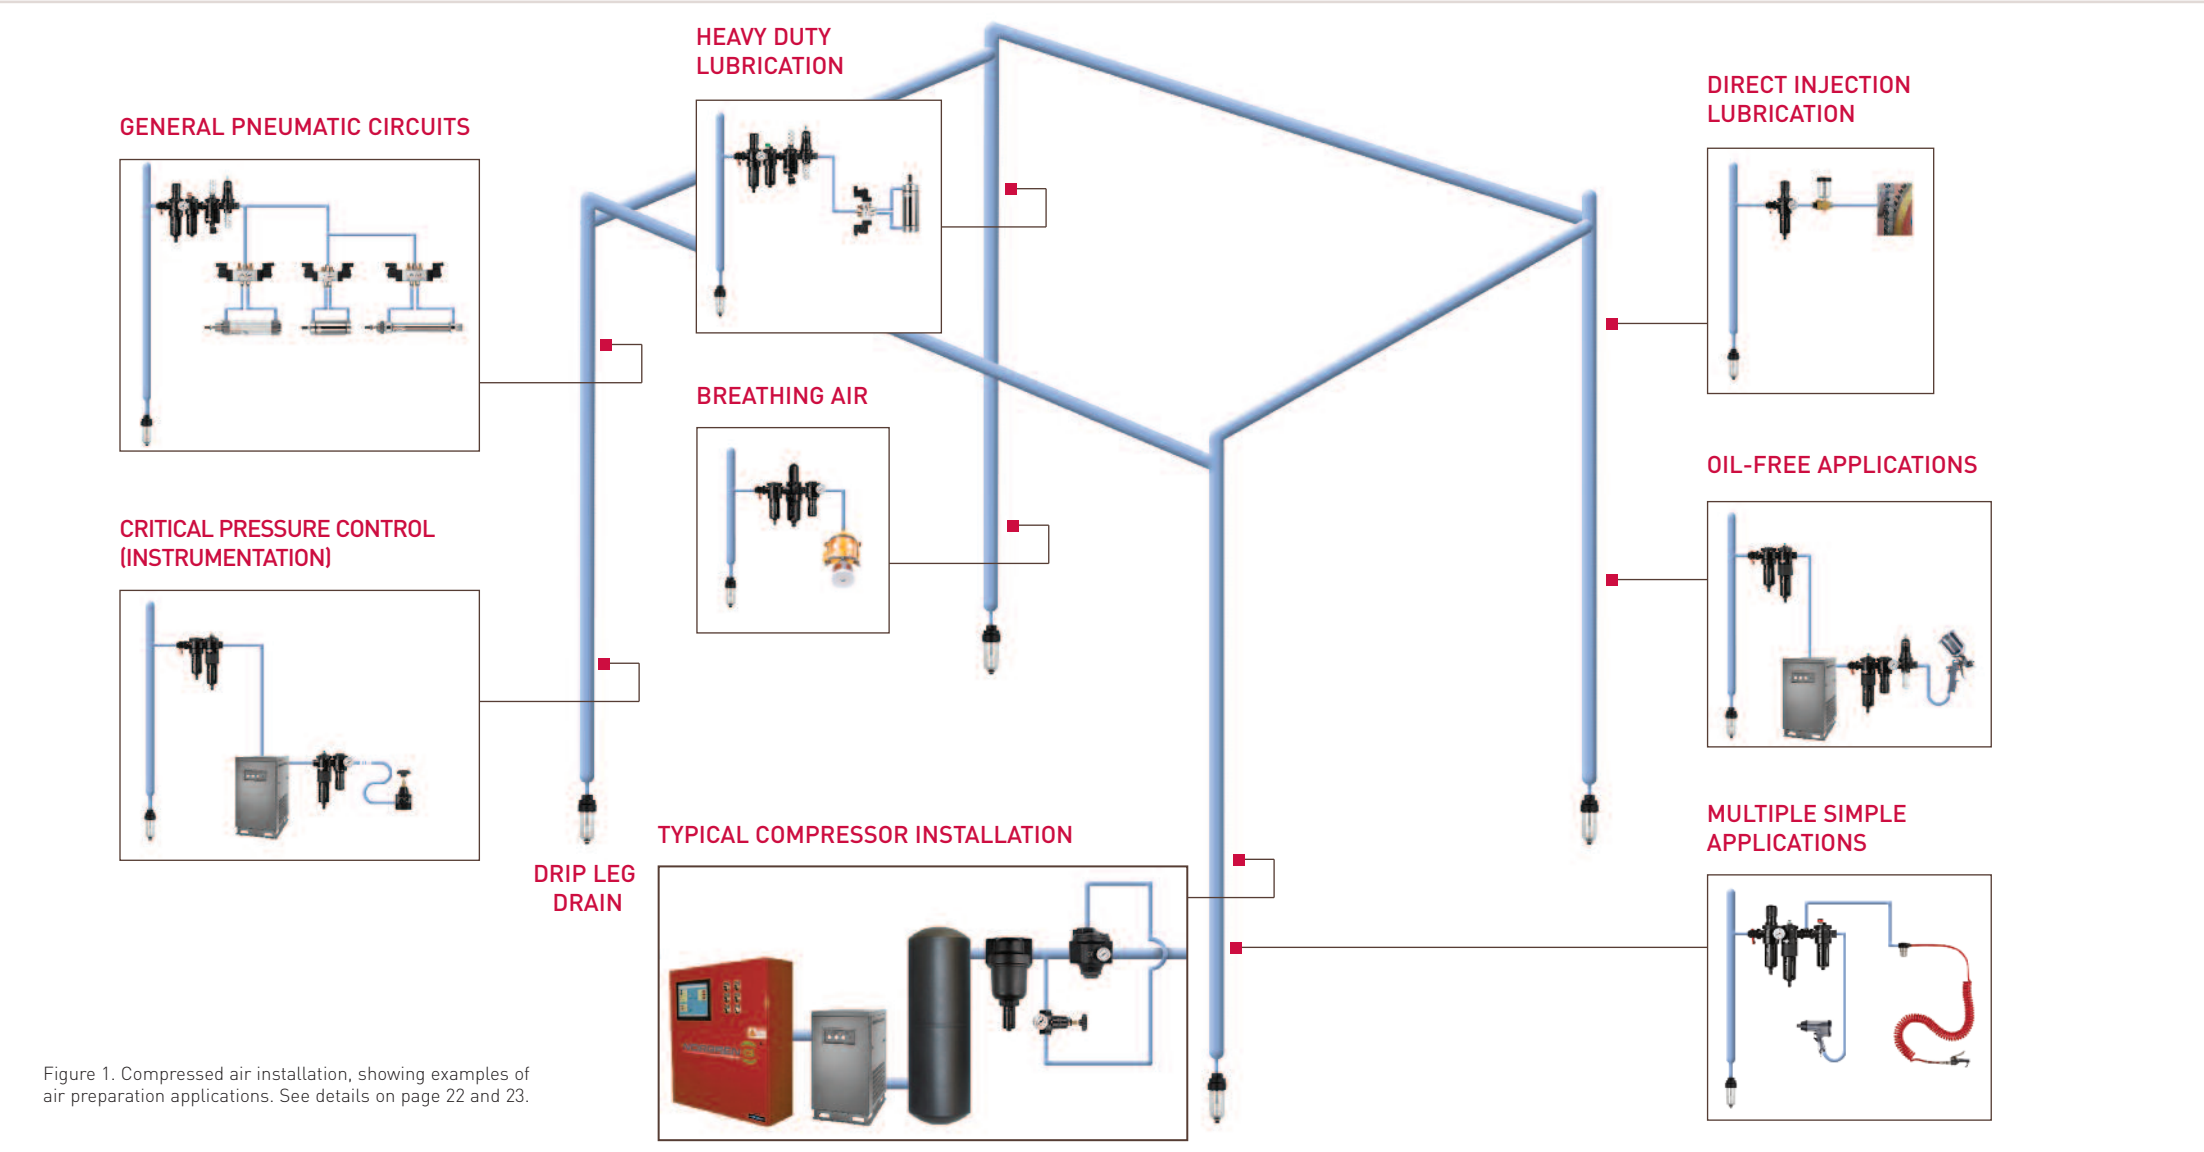


Figure 1. Compressed air installation, showing examples of air preparation applications. See details on page 22 and 23.

Energy Saving - The Norgren guide to saving energy in compressed air systems.

Request your copy by email: advantage@norgren.com or call 0870 890 3620



EVERY CUBIC METRE OF AIR HOLDS AROUND 4 MILLION PARTICLES.

This air is compressed through a compressor to make atmospheric air into a source of potential energy which can then be stored and then used as a source of motive power for pneumatic systems.

In the process of compressing this air heat is generated by the compressor, which in turn heats the air. Most compressors are lubricated and this hot spent, generally acidic lubricating oil finds its way in small quantities into the volume of compressed air along with the particles that

the air contained. (The compressor inlet filters will have removed some of the particles, but by no means all). When air exits the compressor the temperature falls and so any water vapour that existed in the original volume of air, which was condensed and heated by the action of compressing, will be deposited as water when the temperature falls below the dew point of that volume of air. (see CLEANING – water vapour).

A typical 50L/s (100 scfm) compressor will deliver 4500 litres of water and 8 litres of degraded compressor oil into a system in a year along with the particles carried by the air and any wear particles generated by the working of the compressor.

In order for this air to be usable all of this contamination needs to be removed and the air pressure reduced to the optimum for the equipment being operated and in many instances lubricated to extend the operating life of the equipment.



>>GENERATIONDISTRIBUTION AND TREATMENT

Figure 1 shows a typical compressed air installation.

1. The compressor should be situated within a cool, well ventilated but dry environment. Cool air is densest and so the compressor will need to do less work to compress it to a given pressure compared to warm air. Good ventilation will ensure that the air temperature does not build up. This saves on energy costs and will produce less water in the compressed air when it cools.

2. Generally in the UK the compressor and aftercooler are followed by a refrigerant dryer (see CLEANING – dryers), these are typically employed in countries with temperate environments with moderate temperature swings between Summer and Winter. This produces a dew point of around 3-6 degrees C when working correctly and suitable for most factory environments.

When dryer air is required it is best to add additional equipment to that application or section of the plant only. Producing dryer air (lower dew point) is more expensive than the same size refrigerant dryer, so the choice is produce all the plant air to the highest quality, or only produce the best quality at the application that demands it. By far the most cost effective method is the latter. Equipment needed to produce low dew points is not only more expensive and generally requires more energy to run but will also increase the pressure drop to the system. The amount of pressure drop is dependant on equipment selection, but can easily be an extra 0.5 bar. The greater the pressure drop in a system then the higher the generation pressure required from the compressor to overcome it. A guide to the magnitude of this cost is that for every 1 bar increase in generation pressure the energy cost will increase by 7%.

The cost of equipment is also dependent upon flow, large flow needs larger equipment which has a higher installation cost and running costs. From the above it is easy to recognise that the cost of producing very dry air to a small section of a plant will give cost savings on several levels.

3. After the refrigerant dryer the air passes into a receiver, which ideally is situated in the coolest location possible, this will allow any water that may condense out if the temperature falls below the dew point of the air to be drained from the system. These conditions may occur overnight for example.

The receiver is used as a store of potential energy and allows for even running/loading of compressors and for supplying uneven demands into the factory itself. For most UK factories the temperature within the factory is above the ambient (outside) temperature at which the air was stored in the receiver, so unless a local process produces

an extremely high flow or pressure drop combination or the distribution pipes are exposed to severe Winter drafts the temperature should not fall sufficiently to cause more water to condense out at the application. Simple low cost, low pressure drop, mechanical filters can guard against this eventuality.

4. Relatively dry air can then be distributed into the factory using a ring main system. This system gives even distribution of air into the factory as the ring allows air to flow in both directions and prevents air starvation which can occur from simple line (or spur) supply. The variety of applications using compressed air to carry out a multitude of operations can then be fed from this ring main and only the equipment needed for the optimum performance of that application need to be employed. Any piece of air preparation equipment that is not required for the safe operation and optimum performance of any piece of equipment is a source of unnecessary pressure drop and simply adds cost, so should be avoided.

See TYPICAL APPLICATIONS for examples of equipment required for common pneumatic operations.

>> REMOVING CONTAMINANTS

THE AIR PRODUCED BY A COMPRESSOR IS HOT, WET AND DIRTY. THE FIRST STEP IN GOOD AIR PREPARATION IS TO FILTER OUT THESE CONTAMINANTS. THIS SECTION CONSIDERS THE REMOVAL OF LIQUID WATER, WATER VAPOUR, SOLID PARTICLES AND FINALLY OIL.

>> LIQUID WATER

In compressed air systems water vapour exists as a contaminant originating at the compressor outlet in vapour form, but as the air cools, it will exist as both liquid and vapour.

The amount of water vapour that can exist in any given volume of compressed air is directly proportional to the air temperature and inversely proportional to the pressure. Most liquid water will be present when the temperature is lowest and the pressure is highest and removal at this point will achieve the highest efficiency.

In order to achieve this an essential element of any system following the compressor is an efficient aftercooler of sufficient capacity to reduce the temperature of the outgoing air to within 8°C of the temperature of the water entering the aftercooler. Most modern compressor packages contain an efficient aftercooler.

The outgoing air should then be piped to a receiver of adequate capacity located in the coolest location available, definitely not within the compressor house itself. This will permit further cooling of the air to occur and therefore more condensation.

Generally the capacity of the receiver should be around 30 times greater than the rated free air delivery of the compressor when operating in the 7 bar region, typical of most industrial air supplies. See figure 1 for a typical compressor installation.

Further cooling may occur in the distribution mains themselves. These should be laid out with a pitch in the direction of air flow so that gravity and air flow will carry

water to drain legs located at appropriate sites. Down loops in distribution mains should be avoided, if not locate a drain leg at the down loop. With the exception of drain legs all air take-off points from the distribution mains should be taken from the top of the main to prevent water from entering the take-off lines. See figure 1 for a typical good distribution main arrangement.

As stated earlier most efficient water removal will take place at high pressure, so anything which will produce a pressure drop within the distribution system should be avoided. This will also be a loss of energy to the system and increase the cost of compressed air generation. Areas to avoid here are complex flow paths with undue bends and inadequately sized piping. See page 29 Reference Data for friction losses in pipe and for recommended pipe flows.

The action of removing the water can be achieved by drip leg drains, automatic drain valves and as discussed later, filters. These devices should be located in positions where liquid water is present in amounts large enough to be removed (See figure 3). Because of the possibility of cooling occurring during the passage of the air through distribution mains and branch lines it is preferable to install smaller individual filters as near to the actual point of air usage as possible, rather than rely on one large filter adjacent to the air receiver. A point to remember is that since most water will be present at higher pressures, always locate filters upstream of any pressure reducing valves.

Filters which have the ability to remove water are designed for efficient water removal and low pressure drop in accordance with the recommended pipe flows (see page 29) and Norgren filters will have high efficiencies up to 200% of this recommended figure and generally beyond.

>> WATER VAPOUR

A properly designed air line filter of the correct size, in the correct location will effectively and efficiently remove liquid water, but will not reduce the water vapour content of the air. Further air cooling may result in more water condensing out. If complete freedom from water contamination is essential then the water vapour content of the air must be lowered such that the 'Dew Point' of the air is lower than any temperature that the air can be exposed to in the system.

Once all liquid water is removed from compressed air, then normally the air will be completely saturated with water vapour. The particular temperature and pressure at which the compressed air exists at that moment is known as the 'Pressure Dew Point'.

Dew Points are normally measured at atmospheric pressure and can be related to Pressure Dew Points through appropriate charts.



Figure 2.
Typical Compressor Installation

In order to remove water vapour from a compressed air system Air Dryers must be employed. The efficiency of these devices is much increased by ensuring that they are not contaminated by liquid water or oil (or combinations - emulsions) and are supplied with air at the lowest possible temperature. So they are additions to the system and not alternatives to filters and aftercoolers.

There are 4 principle types of Air Dryer;

Refrigerant

Using the same principle as a refrigerator. Air passes across a heat exchanger which has a coolant liquid in it and the air is subsequently cooled and as the temperature drops water vapour condenses out into liquid and is removed. Generally air exiting the dryer passes into a higher ambient temperature and so no further condensation occurs.

Regenerative Adsorbent Desiccant

The desiccant material absorbs the water vapour from the air passing over it and so reduces the dew point of the air. The desiccant material can only adsorb a given amount of water until it becomes saturated. The media can be dried out and then reused. Small discrete dryers can be produced in this manner.

Some dryers can regenerate themselves by incorporating two "towers" of desiccant material and a heater, so that continual drying can take place. One tower being dried and regenerated whilst the other continues to remove water vapour, when this is saturated the process is switched to the other tower.



Figure 3.
Drip Leg Drain

Deliquescent Absorbent

Similar to desiccant except in this case the drying material is ultimately dissolved into the water it absorbs.

Membrane

Air passes through semi-permeable membranes and the water vapour passes through the membrane by a process of plasmolysis (reverse osmosis) and as the water vapour is removed the dew point is suppressed. The amount of suppression is related to the contact time with the membranes and the pressure. So low flows and high pressure will give the lowest dew points.

(The general comparative abilities and comparative costs are tabled in the Reference Data on page 29).

In order to keep the costs of air drying to a minimum consider the following:

- Does the particular process require air drying or will efficient aftercoolers, receivers and filters suffice?
- Do not specify extremely low Dew Points if the process does not warrant them.
- Limit the volume of air being dried to that actually needed for the particular process with an adequate margin for future expansion. This may indicate only one area of a process plant need employ a dryer.
- The major requirement for air dryers in general industrial applications is where high ambient temperatures exist.

>> SOLID PARTICLES

Like water, solid particles exist in any compressed air system regardless of the type of compressor. These can arise from four principle sources:

- Atmospheric dirt inhaled at the compressor inlet port.
- Corrosion products due to the action of water and weak acids formed by the interaction of water and gases such as sulphur dioxide inhaled by the compressor.
- Carbon products formed by the action of the heat of compression on the lubricating oil or the normal wear of the carbon piston rings used in some types of oil free compressors.
- Particles originating from the mechanical fixing of the metal pipe work and components into the air distribution system.

The size of dirt particles covers a very wide range from several hundred to below one micron (see figure 4) and the level of filtration depends upon the degree of cleanliness needed for the particular process involved. Generally it is inadvisable to provide finer filtration than is absolutely necessary because the finer the filtration, the greater the quantity of dirt trapped by the filter element and the more rapidly it will become blocked.

Particles can be broken broadly into two groups, coarse (40 microns and above) or fine. Most normal airline filters will satisfactorily remove particles down to 40 microns. Fine filtration in the region 10–25 µm is normally required for high speed pneumatic tools or process control instrumentation. Filtration of 10 µm and below is essential for air bearings and miniature pneumatic motors. Norgren General Purpose Filters are available with different grades of element to offer these various filtration levels. Some

applications may need filtration better than this and indeed for paint spraying, breathing air and food related applications particle removal below 1 µm is also essential. Standard airline filters cannot be used and high efficiency filters (oil removal/coalescing filters) must be employed. Standard airline filters should still be employed as pre-filters to these high efficiency filters. High efficiency filters will remove these extremely fine particles and if exposed also to the coarser particles they will simply clog and become congested with dirt extremely quickly.

All elements will become blocked in use. For any given application, the finer the filtration, the greater the pressure drop and so the greater the energy cost. Similarly the finer the filter, the faster it will block and increase maintenance costs. The level to which the blocking is acceptable is dependent upon the application and the energy consciousness of the plant operation. Standard filters can be cleaned and reused but in today's environment with labour costs high and spare parts inexpensive it is normally better to replace elements. This will also ensure minimum pressure drop on reinstallation as cleaning at very best will only remove 70% of accumulated particles. High efficiency filter elements cannot be cleaned and must be replaced before they become blocked with dirt. Under normal usage conditions General Purpose filter elements are usually changed before their pressure drop is greater than 0,5 bar, or in routine annual maintenance. It is often best to align the element change with the maintenance schedule of the piece of plant to which it is attached as out-of-phase schedules can often be overlooked. The period can always be adjusted by monitoring for critical applications using a service indicator (figure 7).

High efficiency filters should have their elements replaced no later than when a pressure drop of 0,7 bar is achieved. Again a low cost service indicator is often employed. This device has a scale of two colours, usually green/red. The elements should be changed when or before all red is achieved. Electrical service indicators are also available from Norgren, to provide remote signalling. Maintenance schedules can be produced to ensure this 'last chance' situation is not achieved, indeed some applications cannot tolerate even this much pressure drop, especially if this is at the generation point of a large compressed air distribution main as the cost of extra energy alone would be very large. The most prudent approach to servicing is to change coalescing elements annually as the cost to clean a contaminated system is generally high.

>> OIL

The principle source of oil contamination within a compressed air system is from the compressor. An oil lubricated compressor of 50 dm³/s capacity may introduce as much as 0,16 litres of oil per week into the system. Oil is used for lubrication of the compressor but when it emerges with the compressed air prior to distribution the oil is now in a totally unusable state. Having been subjected to high temperatures during air compression it becomes oxidized and acidic and can be considered as an aggressive contaminant rather than a lubricant and so must be removed. Normal air line filters will remove sufficient liquid oil (along with water) to leave the air in a suitable condition to supply most pneumatic tools and cylinders, but certain processes demand completely oil-free air. One solution is to use oil-free compressors. These will still produce air contaminated with dirt and water and it is often more

economical to use lubricated compressors in conjunction with after coolers and standard air line filters, only fitting high efficiency oil removal filters at the points in the system which demand oil-free air. This ensures that the amount of air needing special treatment is kept to a minimum by allowing a smaller specialized filter in the affected area and not a large specialised filter for the whole plant. This will increase system pressure drop and therefore energy costs as well as maintenance costs. Oil in a compressed air system can exist in three forms, oil/water emulsions, aerosols (small particles suspended in the air) and oil vapours. Emulsions can be removed by standard air line filters but the aerosols are our next concern.

>> OIL AEROSOLS

These particulate oil droplets exist in the airstream and the most troublesome are in the size range 0,01 to 1 micron (approx 90%), the rest may be slightly larger (see figure 4 particle size chart). Most standard airline filters achieve water removal by centrifugal action but due to their small particle size and mass these aerosols are unaffected and require special coalescing filters. In addition to removing the oil droplets these filters will also remove minute water droplets, but they must be protected against gross dirt or water contamination by means of standard air line filters mounted immediately upstream (figure 8). It is normally advisable that these filters are capable of removing particles down to 5 microns or less otherwise the coalescing filter may quickly become choked and blocked with dirt, requiring a filter element replacement.

Figure 4. Particle sizes

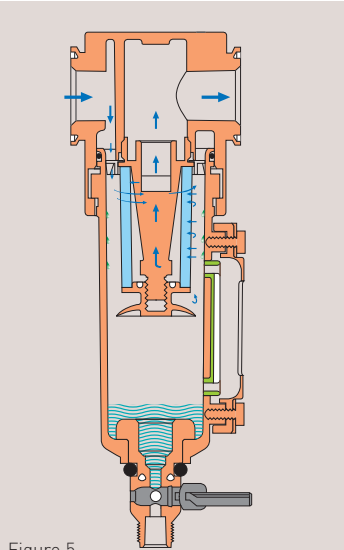
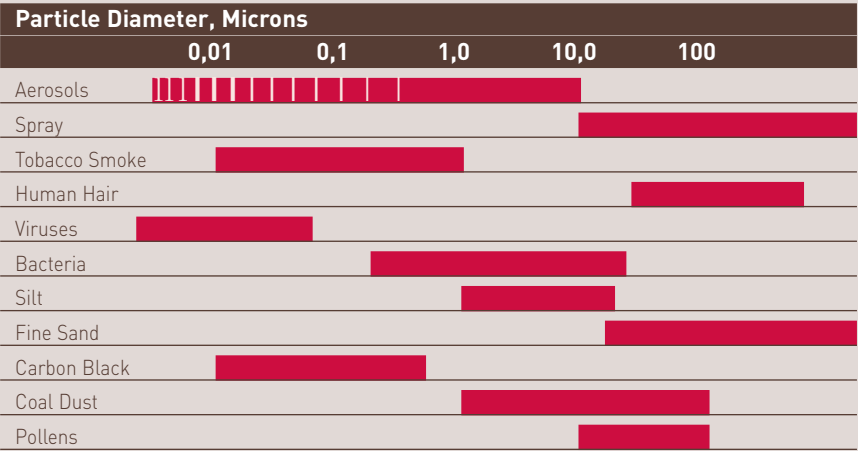


Figure 5. General Purpose Filter

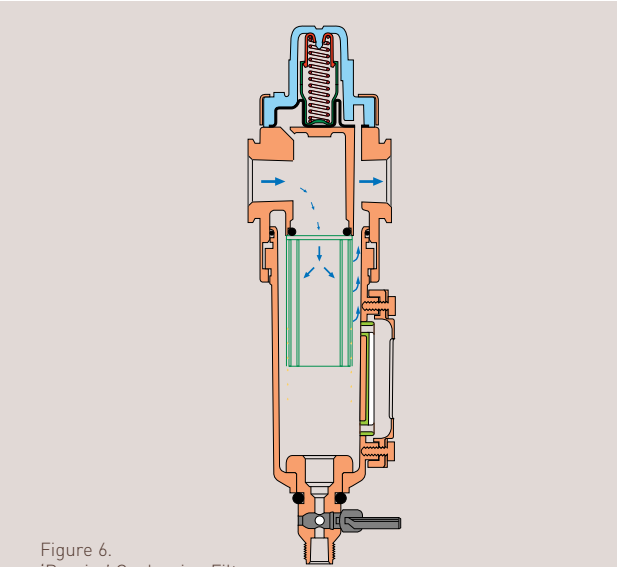


Figure 6. 'Puraire' Coalescing Filter



Figure 7. Filter Service Indicator

Coalescing filters are normally rated by the amount of air which they can ‘process’ to achieve a given oil removal performance, normally a maximum remaining oil content in the exit air of 0,01 mg/m³ (or 0,01 ppm). To try to overflow these units will not only result in a greater pressure drop across the unit and therefore extra energy cost but more importantly the remaining oil content will increase. This may be acceptable for some applications where oil removal down to the order of 0,5 mg/m³ is quite adequate to give a degree of protection to a system particularly prone to gross oil contamination. Figure 11 shows Norgren coalescing filters flow capacities to achieve their given performance.

>> OIL VAPOUR

For most processes the removal of oil vapour is unnecessary since unlike water vapour, oil vapour exists only in minute quantities and is not objectionable except in circumstances where its odour is unacceptable eg. in food processing, pharmaceutical and beverage industries and breathing air applications. The most common method of removal is to pass the air through an adsorbing bed, usually of activated carbon, although other materials can be used. Such vapour removal filters will normally reduce the total remaining oil content when used in conjunction with a prefilter (general purpose filter) and a coalescing filter to 0,003mg/m³. A common misconception of these filters is that they will remove carbon monoxide or carbon dioxide - they will not. As with oil removal (coalescing) filters the vapour removal filters should only be employed where their function is needed, the maximum flow rating is not exceeded and



Figure 8.
Oil removal filter with general purpose pre-filter



Figure 9.
'Ultraire' oil vapour removal filter

they are preceded by a general purpose and a coalescing filter. This will minimise the size of the filters required and therefore the cost of the installation. Norgren offers an integrated coalescing and vapour removal filter in the Olympian Plus range. (See figure 9). This includes a colour change indicator as standard, which indicates the presence of oil aerosols or liquid oil (fault condition). Lifetimes of activated carbon elements are strictly limited to the reactivity of the carbon materials surface. At 21C this is 1000 hours, at higher temperatures this figure drops rapidly. The elements cannot be regenerated and reused. The location of the compressor intake may also have an effect on the level of filtration required, if for example the intake is situated by a source of hydrocarbon vapours etc. Clean air intake will reduce the cost of producing clean compressed air.

>> FILTER SELECTION


Once all of the contaminants have been considered the degree of cleanliness of air for each part of an industrial plant or process can be determined. By only employing the correct filters in the right location energy and maintenance costs can be kept to a minimum. The volume of air involved in each stage must always be considered as undersized, inappropriate filters are a prime cause of high energy costs. Recommendations on air drying are particularly difficult since this is dependant upon the temperature of the compressed air main adjacent to the application/machine the level of pressure reduction and air flow rate. For well laid out generation and distribution systems drying is seldom required in countries of typically low to moderate relative humidities and ambient temperatures, except for specialist applications. When choosing a filter to clean compressed air ensure:

- The correct type of filter and element rating is selected for particle removal.
- The liquid removal efficiency is high and that re-entrainment is not possible.
- Ease of maintenance and liquid condensate collection is possible.
- Easy visibility of condensate and/or element ensures that function is achieved or shows if maintenance is required. This may be a pressure drop device, liquid level indicator or transparent bowl.

In order to aid determining the type of water / particle and oil removal a system or application would generally require, figure 12 shows some typical applications and filtration levels.


Having determined these levels a user can employ suitable filtration equipment to meet these requirements in conjunction with the generation and distribution system employed in their plant. The generation and distribution arrangement having a major effect on the condition of the air arriving at each application point and as previously mentioned duplicate or unnecessary equipment adds to pressure drop and running as well as acquisition costs.

Figure 10.
GENERAL PURPOSE FILTER FLOWS

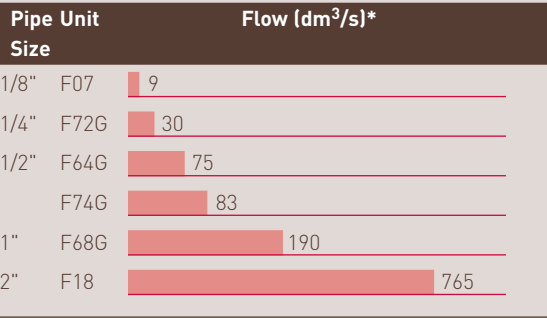

*Flow at 6,3 bar and 0,5 bar pressure drop.

Figure 11.
HIGH EFFICIENCY FILTER FLOWS

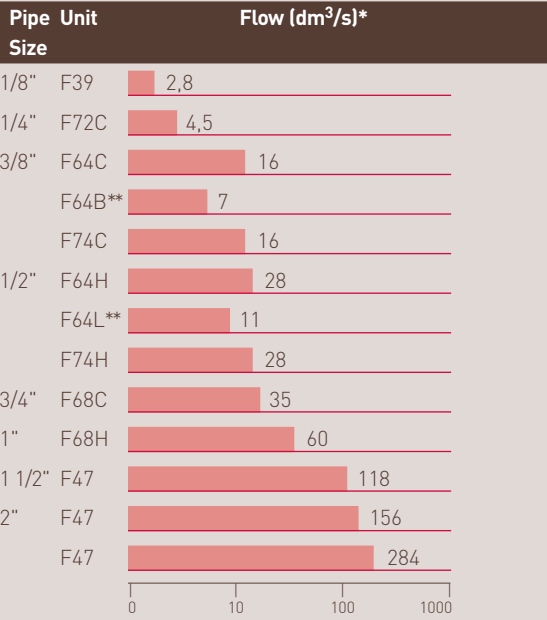

*Flow with 6,3 bar inlet to achieve 'class' requirements.

**Oil and vapour removal combined unit.

Figure 12.
RECOMMENDED FILTRATION LEVELS

Application	Oil or Vapour Removal	Particle Filtration or Pre Filter Size
Air agitation	V	5
Air bearings	O	5
Air gauging	O	5
Air motors	N	40
Brick and glass machines	N	40
Cleaning of machine parts	N	40
Construction	N	40
Conveying, granular products	O	5
Conveying, powder products	V	5
Fluidics, power circuits	O	5
Fluidics, sensors	O	5
Foundry machines	N	40
Food and beverages	V	5
Hand operated air tools	N	40
Machine tools	N	40
Mining	N	40
Micro-electronics manufacture	V	5
Packaging and textile machines	N	40
Photographic film processing	V	5
Pneumatic cylinders	N	40
Pneumatic tools	N	40
Pneumatic tools (high speed)	N	40
Process control instruments	O	5
Paint spraying	V	5
Sand blasting	N	40
Welding macines	N	40
General workshop air	N	40

KEY
N = None
O = Oil Removal
V = Vapour Removal (+ oil removal)
40 = 40 micron General Purpose Filtration
5 = 5 micron General Purpose Filtration

IN ORDER TO USE COMPRESSED AIR MOST EFFECTIVELY AND EFFICIENTLY IT IS NECESSARY TO REDUCE THE PRESSURE TO PRECISELY THE LEVEL REQUIRED FOR ITS APPLICATION.

All pneumatic equipment has an optimum operating pressure. Using it at a higher pressure causes excessive wear, with no significant increase in output, whilst wasting the compressed air itself and the cost expended in generating it. If the compressed air is stored at this higher pressure and only used at exactly the lower level required for the application the storage vessel or receiver need only be topped up from some intermediate figure to the full capacity, which is more efficient. In order to achieve this optimum usage the compressor usually operates between two pressure levels, that is the receiver normally has a pressure switch set to give compressor cutoff at the required storage pressure (usually the highest achievable for filtration efficiency) and a lower level usually about 10 - 20% lower. This figure can be adjusted for the optimum when the receiver size, system flow demand and compressor output rating are considered. The outcome of this arrangement is that the compressor is not continually running, using up excess energy, producing more heat which produces more water, which must be removed (extra cost) to supply a system requirement at too high a pressure which causes excessive wear (extra cost) for no increase in output.

Cylinders rely on the inlet pressure to generate the required force in their application, maybe a crimping operation to achieve a strong mechanical joint. If the generated air from the compressor is simply supplied directly into the mains it will vary both from the compressor loading (cut-in and cut-off settings), but also as other parts of the plant demand air for their applications, giving a greater pressure drop in the distribution ring main. This resultant variation in supply pressure will give a varying crimping force from the cylinder and therefore varying quality, possibly faulty and

reject product.

A pressure reducing valve can therefore generate cost savings greater than its purchase price in a short time period. Also it is mandatory in such applications as blow guns and cooling nozzles where the use of compressed air at high pressure is potentially hazardous. Pressure reducing valves or regulators have two principle characteristics that must be considered in establishing which to select, their ability to keep the outlet pressure constant irrespective of the inlet pressure (called the regulation characteristic) and irrespective of the outlet flow (flow characteristic). Standard designs are manufactured which achieve certain levels of the ideal performance on each characteristic. A simple application with loose demands of the two principle requirements could employ a standard (General Purpose) and therefore low cost reducing valve. The correct selection and deployment in the relevant part of the air system will achieve the lowest cost most energy efficient system.

The penalty for poor regulation characteristics is that the outlet pressure will vary but in the bulk of compressed air applications, inlet pressures are fairly constant so this poses few problems.

The penalty for poor flow characteristics is pressure drop which directly reflects in energy costs. Every regulator suffers from some amount of pressure drop so for good system design this is the more important property to examine.

An important cost saving can be achieved by employing a reducing valve in conjunction with double acting cylinders where a reduced pressure can often be used advantageously on the non-working return stroke and cost savings as high as 30% can be achieved. This can be very important on multi-cylinder installations.

A point common to all pressure regulators is that in order to work constantly and repeatability within their design limits they will require a supply pressure at least 1 bar higher than the required outlet pressure. They will work with a lower differential but performance can be impaired.

>> TYPES OF REGULATOR

Although Norgren produces a vast array of regulators they can be broadly broken into 4 types:

- General Purpose
- Pilot Operated
- Precision
- Special Purpose

Most **general purpose regulators** are of the diaphragm type (figure 13). In general these are more sensitive than piston type regulators which tend to have better flow capacity for a given size. In the majority of compressed air systems response, rather than compactness for a given pipe size is the major requirement, hence diaphragm type regulators are most common.

Regulators can be relieving or non-relieving. The relieving feature allows for the system (outlet) pressure to adjust from a higher level to a lower one without actuating downstream equipment (this is done by having a vent hole through the diaphragm to atmosphere). Generally this relief hole is very small in relation to the regulator main ports so no more than a bleed flow can be achieved and this should not be considered a full relief or even safety relief device.

Non-relieving versions do not have a connection from the downstream system to atmosphere and so can only be adjusted from a higher desired or achieved outlet pressure to a lower one by cycling downstream equipment or using a 3/2 shut-off valve to expel excess air from the downstream system.

Pilot operated regulators are those that do not have a direct mechanical means of adjusting the outlet pressure. This eliminates leverage problems with the manual adjustment mechanisms in achieving high (16 bar plus) pressures in large pipe size units. The outlet pressure is controlled by means of an air pressure signal (figure 14) which is normally produced by a precision regulator. This allows for example a pilot operated regulator to be remotely situated in the large distribution mains normally in a building's roof, but be adjusted to give the desired output pressure from shop floor level. For the majority of pilot operated applications it is best to take the system or outlet pressure reading from the pilot operated (often called a slave or main) regulator itself or the distribution system as the pilot regulator's outlet pressure is generally not the same.

Pilot operated regulators also give better performance by eliminating the control spring and usually have a large diaphragm area compared to valve area which also improves the accuracy of pressure control in response to small pressure changes.

Another level of control accuracy can be achieved by employing a feedback pilot regulator. This device senses the outlet pressure in the system and a piped connection feeds this signal back to the pilot regulator which compares it to the desired outlet signal and 'compensates' by increasing the outlet pressure if the feedback signal is too low, or decreases if the signal is too high. This type of control is usually employed where a large steady air flow to a continuous process is required.

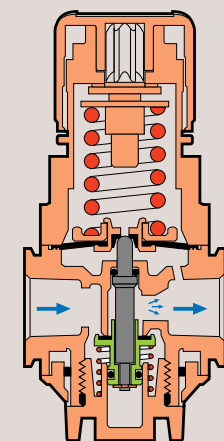


Figure 13. General Purpose Regulator

Precision regulators (or controllers) are normally used for instrumentation applications where exact repeatability and freedom from outlet pressure setting drift over short or long term operation is necessary. These regulators normally have a small outlet flow range, but exhibit superior flow and regulation characteristics. Their ability to achieve the ideal of these characteristics over flow and pressure ranges is reflected in their size and price. Generally most precision regulators employ a special arrangement to allow a constant bleed of air to escape to atmosphere. Although this is a cost to the system as a whole, being a loss of air, it is the price which must be paid in order to achieve the very fast response to the applications demands needed to keep the system pressure as constant as possible. The best types of precision regulators also employ an integral pilot operation, producing effectively two diaphragms and valves, one small and sensitive the other a slave to ensure that the overall performance meets the requirements of the particular application. The bleed flow can either be from the inlet or outlet side of the regulator, with the bleed from the outlet side being at the outlet pressure and therefore the bleed flow will be less, saving energy. Norgren precision regulators are typically of the secondary bleed type and so are more energy efficient.

Special purpose regulators can cover a whole range of specific demands including meeting exact environmental requirements with special materials, having high relief flows, plunger operation in place of handwheels etc. They can be derivatives of any of the other types of regulators with application specific additions. Another type of special purpose regulator has a very high relief capacity and some have the ability to relieve up to 80/90% of their recommended regulated flow for specialist application such as tensioning belts, paper rolling and balancing. (Figure 15).

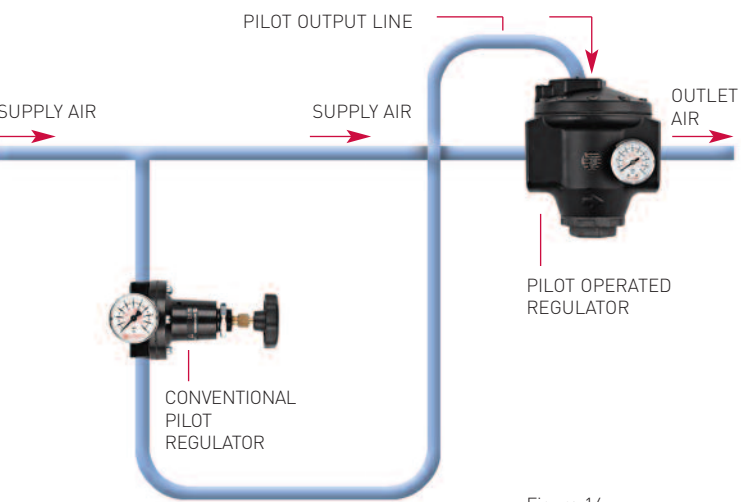


Figure 14.
A typical pilot operated regulator installation.



Figure 15.
Norgren Micro-Trol Special Purpose Regulator

>> **REGULATOR SELECTION**

Ensure the regulator chosen exactly fits the performance requirements of the application. A regulator which controls the pressure to a distribution main is usually of the general purpose type or for large volume/flow applications pilot operated. Decide if the performance requirements need a standard or precision regulator. Then decide if the flow capacity of the regulator is suitable for the pipe size needs (see figure 37) and check with the regulators flow characteristics. Figure 16 shows flow ratings of Norgren General Purpose regulators. If there is no variation in the inlet pressure to an application then the regulation characteristic of the regulator is unimportant but the flow characteristic will be. If the inlet pressure is exposed to variations then the regulation characteristics of the chosen regulator must also be considered. A variety of spring ranges are offered with most regulators. Ideally the regulators should be operated inside the middle third of their range, since at the lower end of their range the spring loses some sensitivity and at the higher end may suffer in linearity. Also low rate springs can help reduce pressure droop, so springs can be selected to best fit the systems requirements. If a precision regulator is required decide on the level of sensitivity, flow and regulation characteristics and if required relief capacity and temperature sensitivity. Select only a regulator suitable for its application. Correct selection could see a general purpose regulator with ordinary performance characteristics fulfilling what may be considered a precision regulators function without system degradation at a lower installed cost and more cost effectively.

Figure 16.
**GENERAL PURPOSE
REGULATOR FLOWS**

Pipe Unit Size	Flow (dm ³ /s)*
1/8" R07	6,5
1/4" R72G	33
1/2" R64G	120
R74G	105
1" R68G	180
2" R18	950

*Flow with 10 bar inlet, 6,3 bar outlet and 1 bar pressure drop.

>> **FILTER/REGULATORS**

Filter/regulators both clean the air to the application and control the pressure in one compact unit. For general purpose applications filter/regulators are usually lower cost than two separate units. The filter/regulator also ensures that the regulator has the best protection it can have. If there is dirt in the system it can lodge on the valve seat of the regulator and cause creep – a fault condition. By using a combined filter/regulator there cannot be anything between the two units eliminating the possibility of putting a source of contamination between them, such as breaking into the pipe between the two units to introduce a tee-piece for another outlet line and leaving some pipe debris.

Some specialist filter/regulators are available for instrument applications with fine particle removal or even oil removal properties with precision regulator characteristics, as are others with special material compatibility.

Figure 17.
**NORGREN FILTER/REGULATOR
FLOWS CAPABILITIES**

Pipe Unit Size	Flow (dm ³ /s)*
1/8" B07	6,2
1/4" B72G	38
1/2" B64G	106
1/2" B74G	100
1" B68G	240

*Flow with 10 bar inlet, 6,3 bar outlet and 1 bar pressure drop.

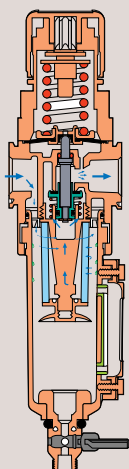


Figure 18.
General Purpose Filter/Regulator



Figure 19.
Instrument Filter/Regulator

THE NEXT IMPORTANT STEP IN PROCESSING COMPRESSED AIR IS THAT OF INTRODUCING INTO THE AIR A SUITABLE AMOUNT OF LUBRICANT, USUALLY OIL TO ENABLE THE OPERATING EQUIPMENT TO PERFORM TO ITS REQUIREMENTS EFFICIENTLY WITHOUT EXCESSIVE RESISTANCE OR WEAR.

Excessive resistance to motion will result in extra power consumption and excessive wear will result in shortened equipment life. Both result in extra cost. A lot of equipment today is produced and labeled as “non-lube”, these are effectively packed with grease to perform the lubrication function. On installation they are full with grease which will be consumed during operation until it is fully consumed and then the device will run dry and wear will increase, along with increasing pressure drop (energy loss = higher running cost) until it fails. Testing of valves and cylinders has shown that employing airline lubrication to these devices will increase their life by a factor of 4. A very marked saving in maintenance costs, both in downtime and acquisition costs. There are two basic types of lubricator in general use, aerosol and injection pump.

>> AEROSOL LUBRICATION

The most widely used is the aerosol, which was the first type of dependable automatic airline lubrication device, invented by Norgren in 1927. Norgren aerosol lubricators are available in two main types, Oil-Fog and Micro-Fog. In an Oil-Fog lubricator the oil aerosol produced generally has relatively large oil particles and so will only remain airborne for relatively short distances. As a general rule of thumb the maximum distance an Oil-Fog lubricator should be placed from the pneumatic device it is to service is 9 metres. Large particles are more strongly affected by

gravity and so Oil-Fog lubricators should not be used in attempting to lubricate a device at a higher level than the lubricator. The Oil-Fog type of lubricator is employed by almost all pneumatic manufacturers of airline equipment. The Micro-Fog lubricator, unique to Norgren uses a special fog generator to atomise only a fraction of the oil. Because the airborne fog is now made up of only light particles, less than about 2 microns in size, gravity does not have the same effect upon it and so this fog can travel not only “up-hill” but also for long distances and through more complex feed lines without wetting out in the pipe. Micro-Fog can also ensure proportionate distribution through multiple lubrication outlets, ideal for multiple valve control circuits. A comparison of these two types of lubricators can lead to a simple division of them as being high delivery (Oil-Fog) or low delivery types (Micro-Fog). All of the droplets of oil shown in the Oil-Fog sight dome will be delivered into the system and for the Micro-Fog only about 5 to 10% of the droplets witnessed will be delivered. The Micro-Fog can therefore be used in applications where only very small amounts of lubricant are required, possibly over large areas. By adjustment of the drip rate higher oil delivery can be achieved to match that of an Oil-Fog lubricator at normal usage rates. The Micro-Fog principle has made possible the application of aerosol lubrication to general machine lubrication such as bearings, gears, chains etc. Both Oil-Fog and Micro-Fog lubricators include a non-return valve in the syphon tube to ensure immediate lubrication as soon as the air is turned on. However for some rapidly cycling duties or systems with small stroke cylinders it is sometimes not possible to lubricate correctly with conventional lubricators. For such applications system modifications such as quick exhaust valves must be employed or a bi-directional lubricator suitably located can overcome such problems. All standard Norgren aerosol lubricators, up to 1” nominal bore are constant density devices. This means that having set the drip rate for a given flow if the flow rate changes, then the amount of oil delivered will also change in direct proportion. So doubling the flow rate will double the oil delivery, so the density of oil in the output air remains the same. This prevents over or under lubrication to ensure even wear and minimum energy loss.

>> CENTRALISED LUBRICATION

It would be ideal to have one central lubricator that will lubricate every pneumatic device in a system, especially if the system is complicated and stretches over a long distance, such as an assembly line in a car plant. Oil need only be filled at one point saving on labour and ensuring that no lubricator is allowed to run dry. Although several versions have been made all based on aerosol lubricators because of the distances involved, these systems are basically flawed. Provided that the consumptions of all the tools and pneumatic devices are constant and that they are continuously in use the system could deliver consistent lubrication. However not every tool has the same consumption and every one will not be working at the same time. This means that the oil delivery to this system must be set at either a maximum demand (highest flow) or at some average figure. This can only result in cycles of over lubrication and under lubrication both of which are detrimental to the system and will lead to increased wear and increasing costs compared to individual or locally grouped lubricators.

>> DIRECT INJECTION

The second type of lubricator, the injection oil-pump is a positive displacement device. Because of its nature it cannot

continuously deliver lubricant but has particular applications in multi-spindle nut runners where conventional lubricators will split air flows according to passageway geometry. The injection pump will deliver the same amount of lubricant to the application point every time it is cycled. This type of lubricator is often used on conveyor chains where their application will overcome problems of incorrectly located or adjusted conventional lubricators. Several such injectors can be manifolded together to lubricate at several different points, but at the same frequency. Whichever type of lubricator is employed it is important to remember that all lubricators are total loss systems in that the dispensed lubricant will reach its ‘bearing’ surface and be broken down into smaller particles and ‘lost’ as the system is cycled. The amount of oil that should be delivered to a pneumatic system to provide sufficient lubrication is difficult to determine because all systems will be different. Pneumatic devices in a system may require different amounts of lubricant and so equipment manufacturers recommendations should always be followed, where they exist. For a general guide for most pneumatic systems an oil output density of 60 mg/m³ is a good basic starting point. In Norgren lubricators 1 drop is approximately 30 mg. From regular inspection and servicing the optimum setting may be found by increasing or decreasing the amount delivered.

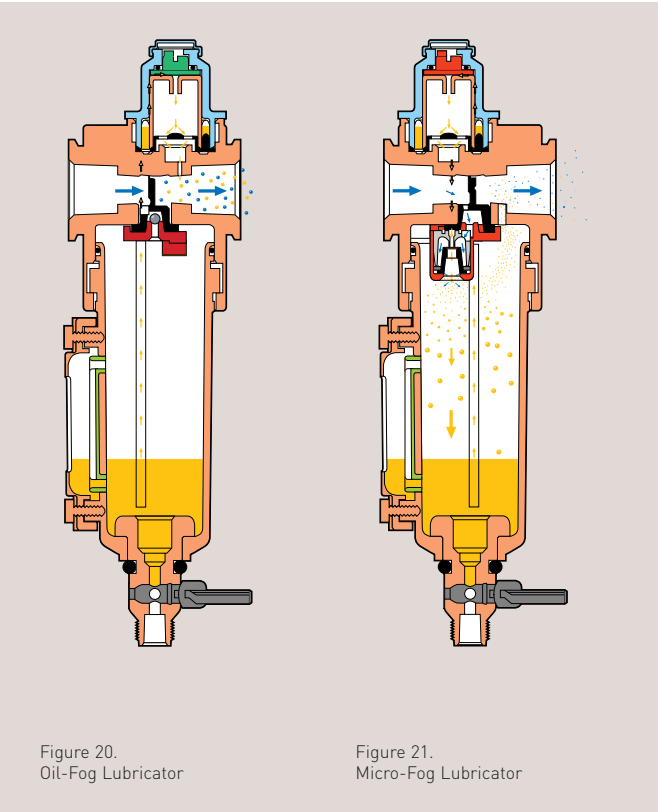


Figure 20.
Oil-Fog Lubricator

Figure 21.
Micro-Fog Lubricator

Figure 22.
LUBRICATOR FLOWS RATES

Pipe Unit Size	Flow (dm ³ /s)*
1/8" L07	5
1/4" L72	24
1/2" L64	72
1/2" L74	70
1" L68	200

*Flow at 6,3 bar and 0,5 bar pressure drop.

>> FILLING LUBRICATOR BOWLS

With all lubricators eventually the bowl or reservoir will need filling. Most Oil-Fog lubricators have a check valve fitted to allow them to be refilled whilst in use. Most Micro-Fog lubricators can be fitted with a quick fill nipple and so be topped up with lubricant, supplied at a pressure of approximately 1 bar above that within the bowl. Remote fill devices also exist which can do this automatically. Such devices can be used to supply several bowls or reservoirs from one central position. Another way to reduce the scheduled task of refilling lubricators or to ensure critical operations never 'run dry' is to employ a liquid level switch. Such devices are normally float operated switches which can give an electrical signal on low or high liquid level. Such signals can then be built into a control system to fill or stop filling or give warning alarms. Although a high level signal may at first seem strange remember that overfilling will not only prevent the lubricator from performing its function of producing an air/oil mix of fog, but will distribute bulk lubricant into the pneumatic system, flooding it.

>> LUBRICATOR SELECTION

Determine which parts of the system require lubrication (some distribution lines will be to oil free areas such as paint spraying or breathing air applications). Determine what type of lubrication is required for each part of the system. Slow moving heavy cylinders need high delivery so choose an Oil-Fog type lubricator. Long runs of pipe in multi-valve circuits require a Micro-Fog (or several Oil-Fog) lubricators to lubricate effectively. High speed tools are better served by a Micro-Fog, as are tips of cutting tools. All lubricators are a source of pressure drop and therefore energy loss, so although Micro-Fogs may be positioned almost anywhere in a system select and place them as conveniently close to the application as possible. Always select lubricators and locate them where different levels of lubrication are required, never attempt to fit one lubricator to supply a whole distribution system as differing parts will then be over lubricated, whilst others are under lubricated. Ensure that only special purpose Micro-Fog lubricators are used for bearing lubrication as other types are not suitable. Check that the lubricator chosen has sufficient flow capacity without excessive pressure drop for the pipe line size being used (see figure 36 and individual lubricator performance graphs). Since lubricators require a minimum pressure drop to operate which is normally related to a flow, ensure that

this minimum flow condition is met or there will be no oil output. It is important to note that leaks from compressed air systems are a source of energy loss and also such leaks are effectively a constant flow through the system. If a lubricator with a very low start point is used then even a small leakage, if in excess of the start point will cause it to drip and supply oil to the system. This is often the cause of oil flooding during periods of shut-down, especially over weekends. Where continual usage exists select a lubricator with sufficient reservoir capacity. For units in 1/2" pipe size and above, several reservoir capacities are usually available. Where this is not possible because of space or usage rate utilise remote fill devices or liquid level switches to auxiliary systems. Where very high flows are encountered use a fixed venturi type lubricator. Unlike standard types this does not automatically adjust to give a constant air/oil density, so the flow requirement needs to be essentially constant. This type of device will then not produce excessive pressure drops associated with high flows and so be more energy efficient. For exceptionally high flow rates small amounts of lubricant (especially for anti-freeze usage) can be injected by small lubricators into large distribution mains of 1 to 2" and above, where a full bore lubricator would be expensive in both cost and pressure drop.

>> EXCESS PRESSURE CONTROL AND ENVIRONMENT PROTECTION

SAFETY IN THE WORKPLACE IS ESSENTIAL AND IS EMPHASISED VIA THE MACHINERY DIRECTIVE, THE PRESSURE SYSTEMS LEGISLATION AND THE PROVISION AND USE OF WORK EQUIPMENT REGULATIONS (POWER).

The following section can help machine designers and others using pneumatics by illustrating those air line products which, when correctly applied, can be used to ensure safe pneumatic systems. In it we have cross referenced relevant documents. Norgren strongly recommend that all who are involved with machine and system design should become familiar with these and other relevant safety documents.

>> OVERPRESSURE PROTECTION

The components in pneumatic systems will often have a pressure rating lower than that generated at the compressor and pressure regulators are used to reduce this pressure to safe efficient levels. In the event of a fault the components can be exposed to excess pressures leading to mis-function or in extremes failure of the pressure containing envelope. To protect against this excessive over pressure situation several solutions can be employed the most common being a relief valve. Selecting a relief valve is not a simple process, and detailed consideration of the system or elements of the system is required. In general all pneumatic components and equipment will have a Safe Working Pressure (SWP) and over pressure limit of 10%. The designer of the pneumatic system can use regulators to run the system at pressures below the SWP and use the 10% safety factor to be the limit of over pressure that the system can experience with the relief valve in operation. A relief valve is defined as a device with its outlet so connected to a pressure system to enable the system pressure to be held at a constant level. This constant level

would then be at or below the stated SWP + 10% over pressure allowance. Relief valves need to be set to only operate when the regulated pressure is exceeded and so need to be set higher than the regulator. There will be a tolerance on the relief valve setting and on the regulators outlet setting, depending on its flow and regulation characteristics. A common problem is a relief setting too close to the system operating pressure. The consequence of this is to have the relief valve operating and venting air during normal system operation, which is an expensive waste of air. Once the relief valve setting pressure and acceptable level of over pressure are checked the flow capacity of the relief device and that of the system can be considered. The relief device must be able to match or exceed the amount of flow through the part of the system being protected without the system pressure rising above the acceptable over pressure level. Several methods can be used to achieve this: The relief device has a flow capacity in excess of the compressors free air delivery capacity - in systems where no receiver exists - i.e. flow out of system is greater than flow in. The relief device has a capacity in excess of the flow through the smallest flow passageway upstream of the equipment being protected. Tables of orifice flow exist to determine the flow at different pressures through differing sizes of orifice. The smallest bore is acting as a restriction to the flow into the downstream system and unless the upstream pressure can be increased the flow will be choked through this area and therefore limited. This is important since a mains distribution system can be of very large volume with pipes of large bore and compressors of high capacity, but the device being protected could be fed by 1/8" nominal bore tubing. So a small low cost device only is required and not one large enough to cope with the full system capacity. In areas where no such flow restriction exists, one should be created in order to reduce the cost of the relief valve to be employed, ensuring of course that the restriction does not cause excessive pressure drop in the course of normal operation. Legislation Reference: 2006/42/EC (replaces BS EN 983 Machinery Directive)

>> TYPES OF RELIEF VALVES

Several types of relief valves exist to achieve different levels of performance with respect to the flow capacity and over pressure limitations. The most common is the 'pop' type, followed by the diaphragm type. For better performance use pilot operated valves with the integral pilot operated type being the most compact and cost effective (figure 23). An "in-line" type of relief device has relief port at 90° to the direction of flow and in normal operation flow passes through the body of the device, without interfering with normal downstream operation. A common use of this type of device is with machine builders, where all the control equipment/protection devices are in one discrete position, aiding both installation and scheduled servicing. The in-line device differs from the pop or diaphragm type of relief valves which are connected into the system on a tee-piece. Flow through these pop or diaphragm type devices only occurs when in operation and air vents to atmosphere. In both cases the exhaust flow can be piped away to an area where the noise and flow will not cause disruption or harm to the environment or the operators. Exhaust silencers may be required to reduce noise levels in high flow exhaust applications where piping away to less sensitive areas is not possible.

>> SOFT START/DUMP VALVES

The next form of protection is that associated with the moving parts of the system, where the parts themselves can need protection against excessive wear due to loading on start up or there is danger to personnel from sudden movement of the parts.

Here the use of "soft start" ("slow start") valves is desirable. The normal operation is to allow air to pass to a pneumatic system or device in a gradual manner, where the rate of pressure build-up can be controlled by adjustment of the valve. The valve design is generally an internal poppet valve which is spring operated and when the gradual pressure build-up produces a force in excess of that holding the poppet closed, the poppet moves to the open position allowing flow to proceed through the normal flow passageways. The level at which the poppet operates is called the snap point and for most devices this snap point will be in the range of 40 to 70% of full line pressure. Because pressure build up in any system is dependant upon the system volume it is important to locate these devices close to the piece of equipment they are to protect. Fitting of a larger valve to a complete distribution system will generally mean the system will take many minutes to fully pressurise. It is extremely common to couple the slow start valve with a dump or exhaust function valve within one body, for compactness. The function of the 'dump' valve is to quickly exhaust the pressure from the downstream system. The valve can have solenoid or air pilot operators and often a manual override or emergency dump function. A further refinement of this device is to introduce a limit switch to the valve spool which can give a signal to show the position of the spool (open or closed), this provides a monitoring function and in conjunction with other valves and relays plus suitable system redundancy can help comply with legislation to make machines safer. Legislation Reference: 2006/42/EC (replaces BS EN 983 Machinery Directive)

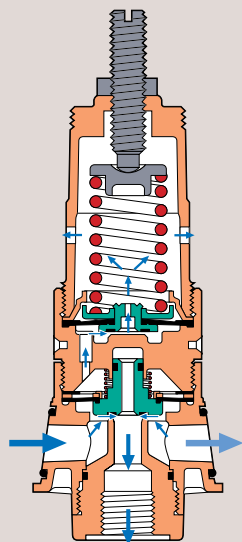


Figure 23.
Internal Pilot Relief Valve



Figure 24.
Soft Start/Dump Valve



Figure 25.
Coalescing Silencer

>> EXHAUST AIR

Exhaust air needs to be treated correctly to reduce the effects of noise, oil mist and to minimise danger to personnel. Where a dump valve is employed, large volumes of air can be released at high speed which will produce high noise levels. Simple silencers made of porous materials are often able to deal with this. In more demanding high velocity cycling applications a heavy duty silencer may be needed. Silencers are normally rated for their noise reduction and associated back pressure so the choice should be dependent upon the duty required of the device to ensure the most cost efficient silencer is utilised. The result of using a silencer with a large back pressure is that it will take longer for the system to exhaust and this may prove to be a safety issue in an emergency stop function. The next major pollutant is oil. All pneumatic lubrication systems are total loss systems, the lubricant goes into the system, gets degraded in its function and is carried along with impurities and dirt to the atmospheric exhaust. In well maintained and correctly lubricated systems of a general engineering nature the amount of exhausting oil is very small and will disperse without generally affecting the working environment adversely. However incorrectly lubricated systems or those which require high levels of lubrication for heavy duty applications can expel high levels of oil into the atmosphere on their exhaust cycle. In such instances use of a coalescing exhaust silencer should be considered. The action of this device is exactly as those for oil removal filters which cause the small oil droplets to merge together into large droplets which fall into a container for removal as liquid oil (see figure 25.) In the course of this process the porous material employed also reduces the noise level of the exhaust air. Since these devices are on the exhaust side of the pneumatic system they are exposed to sudden shock loading, which means their oil removal capabilities are not as good as those employed in coalescing filters. A good exhaust coalescing silencer will however give figures of typically 2 ppm under average usage conditions.

>> PROTECTION DEVICE SELECTION

(i) Decide which parts of the system cannot withstand the maximum pressure which can be developed in the distribution system (or compressor). Determine which type of relief valve is required to control this air pressure most effectively with consideration of failure flow through that part of the system. Consider using a restrictor (orifice) without producing excessive pressure losses in the normal operation of that part of the system.

For very large flows consider a pilot operated regulator as a dump valve. For machines consider an in-line device to build-up one complete integral modular preparation assembly for ease of piping, location and servicing. (ii) Decide upon which parts of the system can suffer from problems on initial start up, or resetting where excessive initial speeds can lead to wear problems or entrapment, or where an emergency stop/dump function is required. Employ one soft start/dump valve for each section of the system operated in this way. The larger the system the longer the dump or emergency stop function will take to fully empty the system. If there is a high safety risk in this part of the machine consider monitored soft start/dump versions along with appropriate other circuitry to comply with the machinery directive. Locate soft start/dump valves in the FRL assembly closest to the downstream end to prevent high back flows through the lubricator. (iii) Where large volumes of air are to be exhausted consider fitting a silencer if the air cannot be piped away to a convenient position. Where rapid cycling of exhaust is present fit a heavy duty silencer. Where the exhaust air can be heavily laden with lubricant, usually from equipment requiring high levels of lubrication fit a coalescing exhaust silencer.

>> OTHER PRODUCTS FOR SAFER SYSTEMS

Other air line products that can help create safe pneumatic systems: Preset pressure regulators – where unauthorised adjustment of the set pressure can be injurious to personnel. Guidance Document: HS (G) 39 Lockable shut-off valves – ensure that a 'safe to work' procedure can be adopted without jeopardy from the unauthorized re-application of pressure. Legislation : 2006/42/EC (replaces BS EN 983 Machinery Directive) Guidance Document HS (G) 39 Tamper resistant kits - can be fitted to pressure regulators, filter/regulators, relief valves and lubricators to ensure that flow, pressure and other settings are secured against unauthorised adjustment. Locking kits can allow for tamper evident lockwires or even padlocks to be employed. Legislation Reference: 2006/42/EC (replaces BS EN 983 Machinery Directive)

THE FOLLOWING SECTION SHOWS SEVERAL TYPICAL SYSTEMS OF A GENERIC TYPE AND THE EQUIPMENT NORMALLY USED FOR THE APPLICATION.

GENERAL PNEUMATIC CIRCUITS

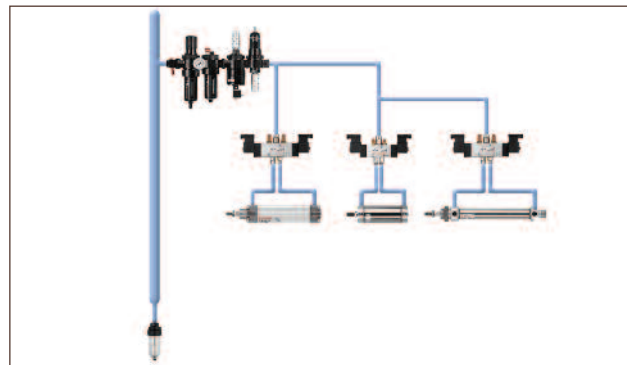


Figure 26. Shut-off valve, filter/reg, Micro-Fog lubricator, soft start/dump, relief valve.

eg: directional control valves and cylinders, in multi-valve circuits, machine cleaning, air motors and high speed tools.
A Micro-Fog lubricator is required for the several varying flow paths to ensure full lubrication. (Figure 26).

BREATHING AIR



Figure 28. Shut-off valve, general purpose filter, Ultraire filter, regulator.

eg: face masks and hoods, air agitation.

The typical application assumes that air intakes are of a reasonable quality with no CO or CO₂ contamination. It may in some instances be a consideration to remove water vapour. (Figure 28).

MULTIPLE SIMPLE APPLICATIONS

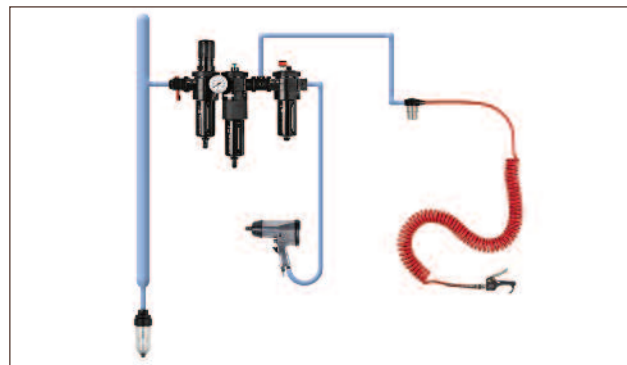


Figure 27. Shut-off valve, filter/regulator, oil removal filter, porting block, Micro-Fog lubricator.

eg: Machine Centre or OEM machines.

It is often a case that with fairly simple machines, lubricated air is required for valving and pneumatic circuitry and oil-free air for air bearings. To keep costs low two separate lines are unnecessary and a typical arrangement from one air supply only can be arranged as shown. Other elements such as pressure switches and check valves may be made available within modular systems. (Figure 27).

OIL-FREE APPLICATIONS

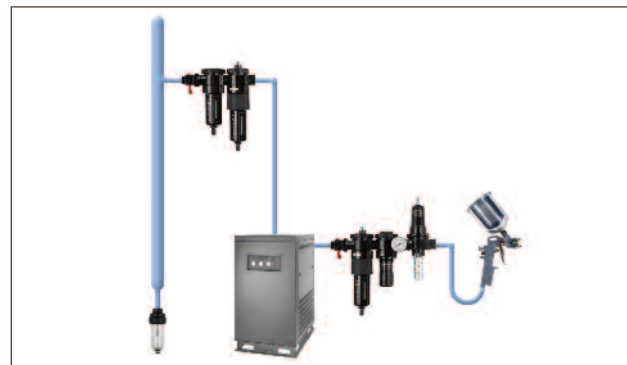


Figure 29. Shut-off valve, general purpose filter, oil removal filter, dryer, oil removal filter, regulator, relief valve.

eg: paint spraying, foodstuffs, film processing, powders.

These applications need to be free from any water deposits in the downstream system. For many installations this will require air drying. The dryer itself will need protecting from oil to allow it to work efficiently and the downstream system will also need protection from accidental migration of the material into it in the case of desiccants. A typical arrangement would be as (Figure 29) and in some instances it might be worth considering an oil vapour removal filter too.

Remember every system should be treated on its merits and broken down into several elements to ensure optimum installation, running and maintenance costs are achieved. The applications below are typically branches taken off a large works distribution mains and isolating valves are usually placed in front of all branches to permit isolation

from the mains to allow for maintenance to take place without recourse to complete plant shut-down. For expert advice on the right equipment for your application contact Norgren at advantage@norgren.com or call **0870 890 3620**.

HEAVY DUTY LUBRICATION

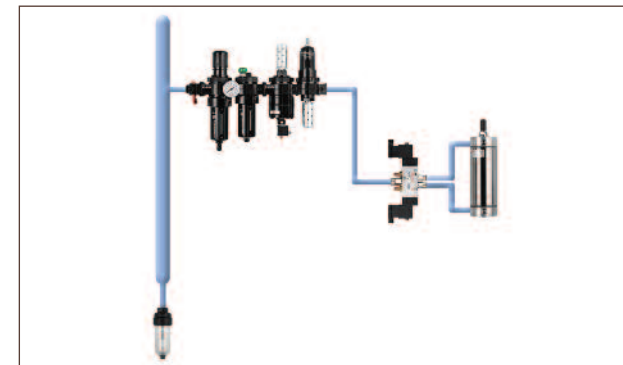


Figure 30. Shut-off valve, filter/reg, Oil-Fog lubricator, soft start/dump valve, relief valve.

eg: large slow moving cylinders.

In such applications large amounts of lubricant are required for effective lubrication. Again a soft start/dump valve is shown but is dependent upon the application. (Figure 30).

DIRECT INJECTION LUBRICATION

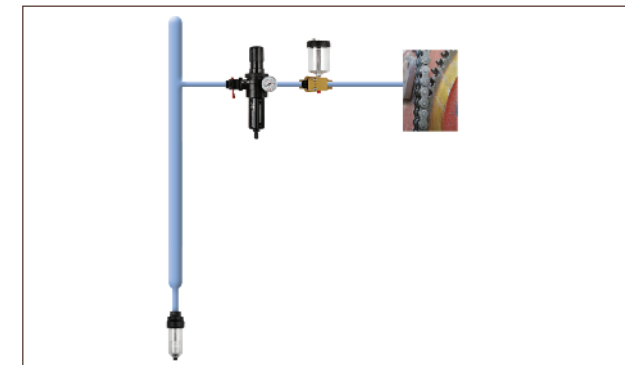


Figure 32. Shut-off valve, filter/reg + direct injection lubricator.

eg: conveyor chains.

The application does not allow for 'fog' type lubrication because of the surrounding environment and absence of a lubrication chamber. (Figure 32).

CRITICAL PRESSURE CONTROL (INSTRUMENTATION)

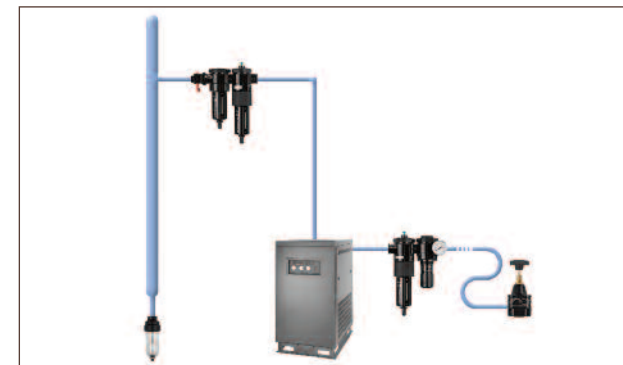


Figure 31. Shut-off valve, general purpose filter, oil removal filter, dryer, oil removal filter, regulator and precision regulator.

eg: precision regulation, fluidic systems, air gauging, process control.

A typical arrangement is shown, where oil aerosols that can prevent fast response of downstream devices, need to be removed. Dependant upon air quality drying may not be required. Depending on application and distances a general purpose regulator may not be needed. (Figure 31).

>> NORGREN AIR PREPARATION PRODUCT OVERVIEW

THESE PAGES SHOW THE MAIN PRODUCT FAMILIES, TOGETHER WITH JUST A FEW OF THE MORE SPECIALISED STANDARD PRODUCTS.

In addition we produce hundreds of products to customers specifications, utilising the vast experience Norgren has accumulated over more than 80 years.

All the main ranges include:

- General Purpose Filters
- High Efficiency Filters
- Vapour Removal Filters
- General Purpose Regulators
- Filter/Regulators
- Oil-Fog and Micro-Fog Lubricators
- Soft Start/Dump Valves
- Shut-Off Valves
- Relief Valves

Some include:

- Coalescing Silencers
- Desiccant Dryers
- Membrane Dryers

These are supported by a wide choice of mounting methods and accessories

- Porting Blocks
- Pressure Switches
- Level Controls
- Service Indicators
- Manifold Blocks

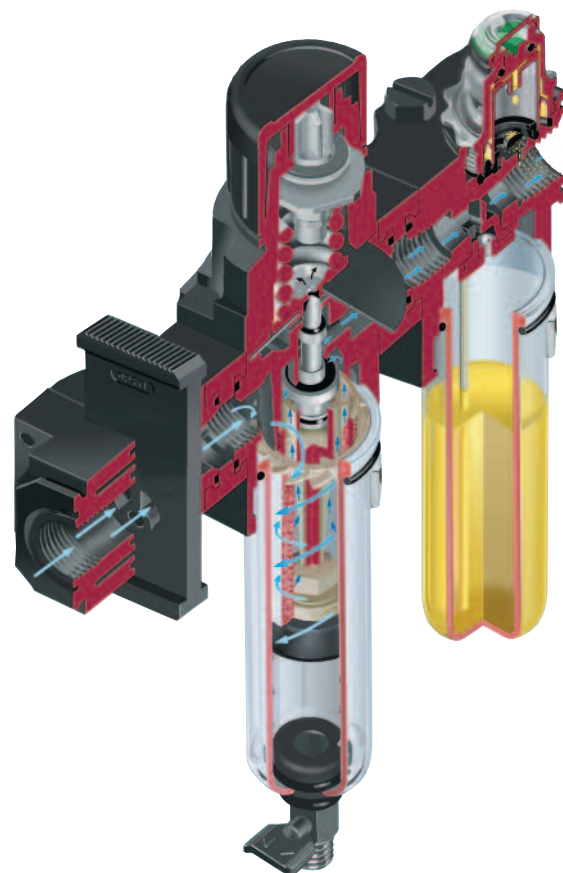


Figure 33.
Excelon System - Typical workings of an air preparation assembly.

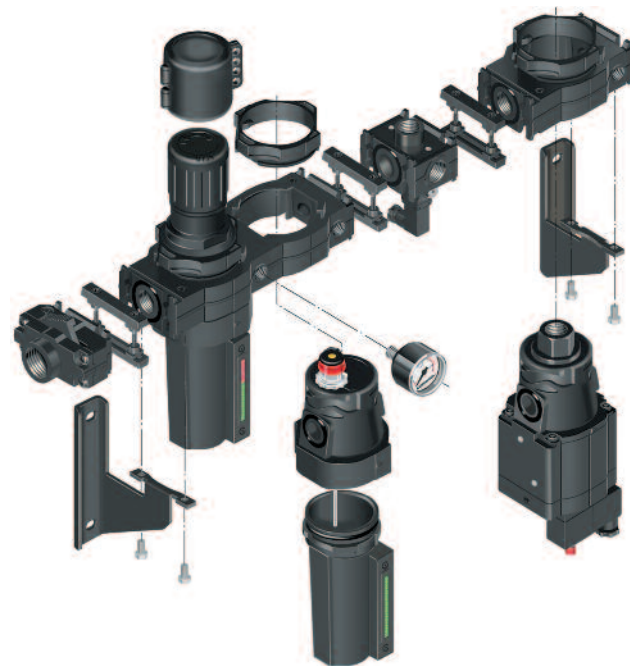


Figure 34.
Olympian Plus System - Typical elements and features of a modular system.

>> OLYMPIAN PLUS



OLYMPIAN PLUS 64 SERIES

Olympian Plus is based on the original Olympian system, with updated features.

The unique plug in feature allows quick installation or removal of units with a simple quarter turn of the clamp ring. The easily connected yoke systems allows speedy assembly of combination units and due to its design units cannot be replaced back to front. Still the fastest swap out of any existing airline modular system, giving minimum downtime and cost. Over 7 million Olympian "holes" sold prove this to be the most popular and successful modular air preparation system.

Packed with features to make field maintenance easy and convenient Olympian Plus is ideal for industrial installations. Equally the wide range of system accessories mean it offers the OEM user a highly flexible solution.

Olympian Plus is available in basic 1/2 inch, with optional 1/4, 3/8 and 3/4 porting.

OLYMPIAN PLUS 68 SERIES

The 68 Series is the basic 1" version of the Olympian Plus system, based on the Olympian 15 series. Available in 3/4 through 1 1/2 inch ports it offers a flexible solution for larger machines and high flow industrial use.

>> EXCELON



Excelon is the alternative air preparation system from Norgren. Although direct ported, thanks to a patented Quikclamp connection system, Excelon can be used where both stand alone units or modular assemblies are required. It offers exceptional performance in a compact well styled unit. It is ideal for OEM's offering a flexible modular system with useful accessories such as pressure switches and manifold blocks. The quick release bayonet bowl, high visibility liquid level indicator and easy to operate patented Quikdrain are just a few of the features designed with ease of maintenance in mind.

There are three sizes in the Excelon range:

EXCELON 72

The 72 is a basic 1/4 inch range (with optional overporting to 3/8). However there is nothing basic about its performance, which is actually better than many competitors 3/8 products.

EXCELON 73

The 73 is a basic 3/8 inch range (with optional 1/4 and 1/2).

EXCELON 74

The 74 is a 1/2 inch range (with optional 3/8 and 3/4) with performance the same as Olympian Plus 64 series.



>> EXCELON PRO



Excelon Pro is a new basic 1/4 inch range of light weight units. A basic range designed to meet all the needs of small general pneumatic systems is a small compact light weight package. Excelon Pro has uniquely interchangeable end connectors that lock into position and give the range complete flexibility from 1/8 to 3/8 inch threaded ports or 6mm to 10mm PIF connections for direct connection without the cost of fittings and no leakage. These end connectors can be simply changed by hand without the need for any tools. Integral brackets and gauges make this range simple for specifying and installation. The end plates also allow for the inlet connection to be a different size or form to the outlet, so no need to ever mix up the inlet port.

>> PORTED UNITS



The ported products have no modular connection system, and are generally used as stand alone units. They cover a wide range of basic port sizes from 1/8" (07 Series) through 2" (18 Series). These two sizes being the most important due to size and weight considerations.

07 SERIES

The miniature range offers good performance units for smaller flow requirements. Here regulators are the most common product and in addition to the catalogued units Norgren offers a vast array of options. Units are available in a range of body materials, with internal components chosen to deliver the specific performance characteristics requested by the customer.

18 SERIES

The 18 Series is a basic 2 inch range designed for factory air mains or high flow OEM applications such as shot blasting or textile machines. Due to size and flow capacity, regulators in this series are pilot operated and an instrument or precision unit is normally employed with them to give excellent flow and response characteristics, especially when used with a feedback pilot regulator.

>> PRECISION AND SPECIAL PURPOSE REGULATORS



Norgren has several different precision regulators, each offering the designer a particular combination of performance characteristics from which to select the best unit for the application. Many specials are produced in addition to the catalogued options.

11-818

Compact, high precision regulators, extremely accurate and repeatable, even at very low pressures. Can be used in laboratories or anywhere where the best control is needed even at high 1/4 inch flows, up to 10 dm³/s. Secondary bleed makes it more energy efficient and less costly to use than almost all major competitors units.

11 400

Robust industrial design and easy to adjust, normally used for air gauging or high accuracy pilot control of large regulators and relief valves.

R24 MICRO TROL

Exceptionally high flow regulator with excellent relief performance.

20AG

Industrial pressure regulator with large flow, small pressure drop and very fast response to changing pressures.

R38

Instrument regulator produced in aluminium or stainless steel. Excellent performance without a constant bleed and with non-relieving option make this ideal where inert gases must be used as a pilot regulator.

>> SPECIALISED PRODUCTS

**STAINLESS STEEL**

Norgren produces units which meet NACE requirements for use offshore and in harsh process environments. The 38 Series regulator and filter/regulator are 1/4 NPT instrument units offering high flow with very good precision. General Purpose 1/2 NPT units are available (3/8 or 3/4 options) for higher flows. The 22 Series filter, regulator and lubricator are basic 1/2" and for lower flow applications. The 1/4" 05 Series is a General Purpose compact version of regulator or filter/regulator for low flows or portable applications.

WATER REGULATORS

Regulators with plastic or brass bodies suitable for general or potable water duty.

RELIEF VALVES

In addition to the relief valves that are part of the main FRL families Norgren has several specialised units including Pop Type and the air piloted 40AC to enable protection for all systems against overpressure, vital for all safe systems.

>>GLOSSARY

After Cooler

A heat exchanger mounted on a compressor outlet to extract the heat of compression.

Ambient

The conditions, usually temperature, in the vicinity of the equipment under normal working conditions.

Back Pressure Regulator

A device connected to a system in such a way that the system pressure is held effectively constant by control of the outlet flow to atmosphere.

Check Valve

A device which allows flow in one direction only.

Coalescing

The action causing small particles to unite to form larger particles.

Constant Bleed

Small continuous escape of air, usually from a precision regulator to aid in performance.

Deliquescent Dryer

A dryer using material which absorbs water vapour to such an extent that the material ultimately dissolves into the water it absorbs.

Desiccant

An adsorbing material used in some dryers. Many such dryers are regenerative in that they use some of their energy to dry the material making it suitable for reuse.

Drip Leg Drain

A device at the bottom of a down leg from a distribution main or a system low spot to remove condensed water from the system. Such devices are normally fitted with automatic drain valves.

Dump Valve

A valve which is connected to atmosphere in such a way as to rapidly exhaust the system pressure.

Emulsion

A mixture of oil and water.

Failure Flow

The maximum flow through a device at a given pressure with the valve open to maximum extent.

Flow Characteristics

A characteristic of a pressure regulator which shows the variation of outlet pressure with varying outlet flow rates at a constant supply pressure.

Free Air

Air flow measure in dm3/s at STP (1 013mbar and 21°C) (ISO R554). All air flows are converted to this to make system sizing easier.

Initial Droop

The amount of pressure drop incurred by a pressure regulator in going from a flow (static) condition to a small flow (dynamic) condition.

Membrane Dryer

A device which uses semi-permeable membranes to remove water vapour from air to reduce the dew point of the air.

Micro-Fog

A suspension of light oil fractions in air, typically less than 2 µm in size which can travel long distances, through complex passageways.

Micron (micrometre)

A measurement of size on millionth of a metre (symbol µm).

Oil-Fog

A suspension of oil fractions in air, heavier and larger than Micro-Fog, suitable for heavy duty lubrication.

Pilot Operated Regulator

A regulator which has its outlet pressure controlled by the outlet pressure of another (piloting) pressure regulator, and not by an integral adjustable spring load as with standard pressure regulators.

Porting Block

A modular device for allowing several air take-off from a main air flow control set.

Pressure Drop (Droop)

The amount of pressure loss incurred by the flow of air through a device.

Pressure Reducing Valve/Pressure Regulator

A device which is used to lower air pressure in a pneumatic system to a desired working level.

Regulation Characteristic

A characteristic of a pressure regulator which shows the variation of outlet pressure with varying inlet pressure at a constant flow rate.

Relative Humidity

The ratio of the actual amount of water vapour present in a given volume of air, to the amount of water vapour necessary to saturate the same volume of air at the same temperature.

Soft Start Valve

A device which on initial pressurization of a system allows the pressure to build up slowly to a pre-determined intermediate level before allowing a step-up to full line pressure to be achieved.

>>REFERENCETABLES

Figure 35.

FRICION LOSS IN PIPE FITTINGS IN TERMS OF EQUIVALENT METRES OF STRAIGHT PIPE

	8 mm	10 mm	15 mm	20 mm	25 mm	32 mm	40 mm	50 mm
Tee (straight through)	0,15	0,15	0,21	0,34	0,46	0,55	0,67	0,92
Tee (side outlet)	0,76	0,76	1,01	1,28	1,62	2,14	2,47	3,18
90° elbow	0,43	0,43	0,52	0,64	0,79	1,07	1,25	1,59
45° Elbow	0,15	0,15	0,24	0,30	0,38	0,49	0,58	0,73
Ball valve*	0,01	0,03	0,09	0,12	0,15	0,22	—	—

*Self exhausting – full open

Figure 36.

MAXIMUM RECOMMENDED FLOW *THROUGH ISO 65 MEDIUM SERIES STEEL PIPE

Applied Gauge Pressure bar	Nominal Standard Pipe Size (Nominal Bore) – mm										
	6	8	10	15	20	25	32	40	50	65	80
	Approximate Pipe Connection – inch										
	1/8	1/4	3/8	1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3
0,4	0,3	0,6	1,4	2,6	4	7	15	25	45	69	120
1,0	0,5	1,2	2,8	4,9	7	14	28	45	80	130	230
1,6	0,8	1,7	3,8	7,1	11	20	40	60	120	185	330
2,5	1,1	2,5	5,5	10,2	15	28	57	85	170	265	470
4,0	1,7	3,7	8,3	15,4	23	44	89	135	260	410	725
6,3	2,5	5,7	12,6	23,4	35	65	133	200	390	620	1 085
8,0	3,1	7,1	15,8	29,3	44	83	168	255	490	780	1 375
10,0	3,9	8,8	19,5	36,2	54	102	208	315	605	965	1 695

*Air flow rates in dm³/s free air at standard atmospheric pressure of 1 013 mbar.

General notes

The flow values are based on a pressure drop (ΔP) as follows:
10% of applied pressure per 30 metres of pipe 6 – 15 mm nominal bore inclusive
5% of applied pressure per 30 metres of pipe 20 – 80 mm nominal bore inclusive

Figure 37.

DRYER COMPARISON

Dryer Type	Pressure Dew Point	Atmospheric Dew Point	Drying Media Replacement	Power Consumption	Initial Cost	Pre Filters	After Filters	Maintenance Cost
Refrigerated	2°C	–23°C	Nil	For refrigeration motor	Medium	General purpose and coalescing	None	Regular maintenance of refrigeration
Regenerative Desiccant	–40°C	–57°C	Infrequent	For drying desicant	High	General purpose and coalescing	Coalescing	Small
Deliquescent	10°C	–15°C	Regularly, minimum 6 monthly	Nil	Low	General purpose and coalescing	Coalescing	Recharging container
Membrane	–40°C	–57°C	Nil	10% airflow	Medium	General purpose and coalescing	None	None

>> NOTES

>> NOTES

AUSTRALIA

Tel: +61 3 9213 0800
 Fax: +61 3 9213 0890
enquiry@norgren.com.au

AUSTRIA

Tel: +43 22 36 63 520
 Fax: +43 22 36 63 520 20
enquiry@at.norgren.com

BELGIUM & LUXEMBURG

Tel: +32 2 333 44 11
 Fax: +32 2 333 44 88
enquiry@be.norgren.com

BRAZIL

Tel: +55 11 5698 4000
 Fax: +55 11 5698 4001
vendas@norgren.com.br

CANADA

Tel: +1 303 794 2611
 Fax: +1 303 795 9487
inquiry@usa.norgren.com

CHINA

Tel: +86 21 2416 1800
 Fax: +86 21 2416 1900
info@norgren.com.cn

CROATIA

Tel: +386 4 5317550
 Fax: +386 (64) 7000949
info@si.norgren.com

CZECH REPUBLIC & SLOVAKIA

Tel: +420 465 612 879
 Fax: +420 465 612 908
info@cz.norgren.com

DENMARK

Tel: +45 44 91 41 66
 Fax: +45 44 91 15 60
norgren@norgren.dk

FINLAND

Tel: +358 95 712 140
 Fax: +358 95 712 1440
arki@norgren.fi

FRANCE

Tel: +33 1 60 04 95 95
 Fax: +33 1 60 43 18 86
norgren@norgren.fr

GERMANY

Tel: +49 2802 49-0
 Fax: +49 2802 49356
info@norgren.de

HONG KONG

Tel: +852 2492 7608
 Fax: +852 2498 5878
enquiry@norgren.com.hk

HUNGARY

Tel: +36 1 284 9000
 Fax: +36 1 284 8980
info@norgren.hu

INDIA

Tel: +91-120-4089500
 Fax: +91-120-4089599
enquiry@norgren.co.in

IRELAND

Tel: +353 1 8300 288
 Fax: +353 1 8300 082
dublin@norgren.com

ITALY

Tel: +39 039 60 631
 Fax: +39 039 60 63 301
info@norgrenitalia.it

JAPAN

Tel: +81 6 6876 8913
 Fax: +81 6 6876 8929
toiawase@norgren.co.jp

MALAYSIA

Tel: +60 3 5121 9255
 Fax: +60 3 5121 2889
sales@norgren.com.my

MEXICO

Tel: +52 55 1500 64 00
 Fax: +52 55 1500 64 30
neumatica@norgren.com.mx

NETHERLANDS

Tel: +31 (0)36 548 6828
 Fax: +31 (0)36 548 6838
enquiry@nl.norgren.com

NEW ZEALAND

Tel: +64 9 579 0189
 Fax: +64 9 526 3398
enquiry@norgren.co.nz

NORWAY

Tel: +47 22 90 80 80
 Fax: +47 22 90 80 81
norgren@norgren.no

POLAND

Tel: +48 22 518 9530
 Fax: +48 22 518 9531
biuro@norgren.pl

ROMANIA

Tel: +40 31 425 17 06
 Fax: +40 31 425 17 08
office@norgren.ro

RUSSIA

Tel: +7 499 729 56 09
 Fax: +7 499 729 57 49
sales@norgren-imi.ru

SINGAPORE

Tel: +65 6862 1811
 Fax: +65 6862 1886
sales@norgren.com.sg

SLOVENIA

Tel: +386 4 531 7550
 Fax: +386 4 531 7555
info@si.norgren.com

SPAIN

Tel: +34 93 748 9800
 Fax: +34 93 783 0838
norgren@norgren.es

SWEDEN

Tel: +46 40 59 51 00
 Fax: +46 40 49 50 90
info@norgren.se

SWITZERLAND

Tel: +41 71 973 82 00
 Fax: +41 71 973 82 01
norgren@norgren.ch

TAIWAN

Tel: +886 33162673
 Fax: +886 33162910
enquiry@norgren.com.tw

THAILAND

Tel: +66 2750 3598/99
 Fax: +66 2750 3855
sales@norgren.co.th

UK

Tel: +44 1543 265 000
 Fax: +44 1543 265 827
advantage@norgren.com

USA

Tel: +1 303 794 2611
 Fax: +1 303 798 4856
inquiry@usa.norgren.com

Supported by distributors worldwide
www.norgren.com

The Roundel, 'Norgren' and 'IMI' are registered trade marks
 © Norgren Limited 2011.
 Due to our policy of continuous development, Norgren reserve the right to change specifications without prior notice.

Legislation correct at time of going to print.

z7151 en/02/11